

HEAT PUMP JOBSITE SHEET

REMEMBER:

1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Sat. Temp. is pressure converted to Temp.

Formula For Super Heat

Vapor Line Temp. _____

Minus Sat Temp. _____

Equals Super Heat _____

Formula For Sub Cooling

Sat Temp. _____


Minus Liquid Line Temp. _____

Equals Sub Cooling _____


Circle One

Heat Mode

Cool Mode



Low side PSIG



High side PSIG


Saturation Temp.

Saturation Temp.

Inside Temp. Leaving

DB: _____

WB: _____

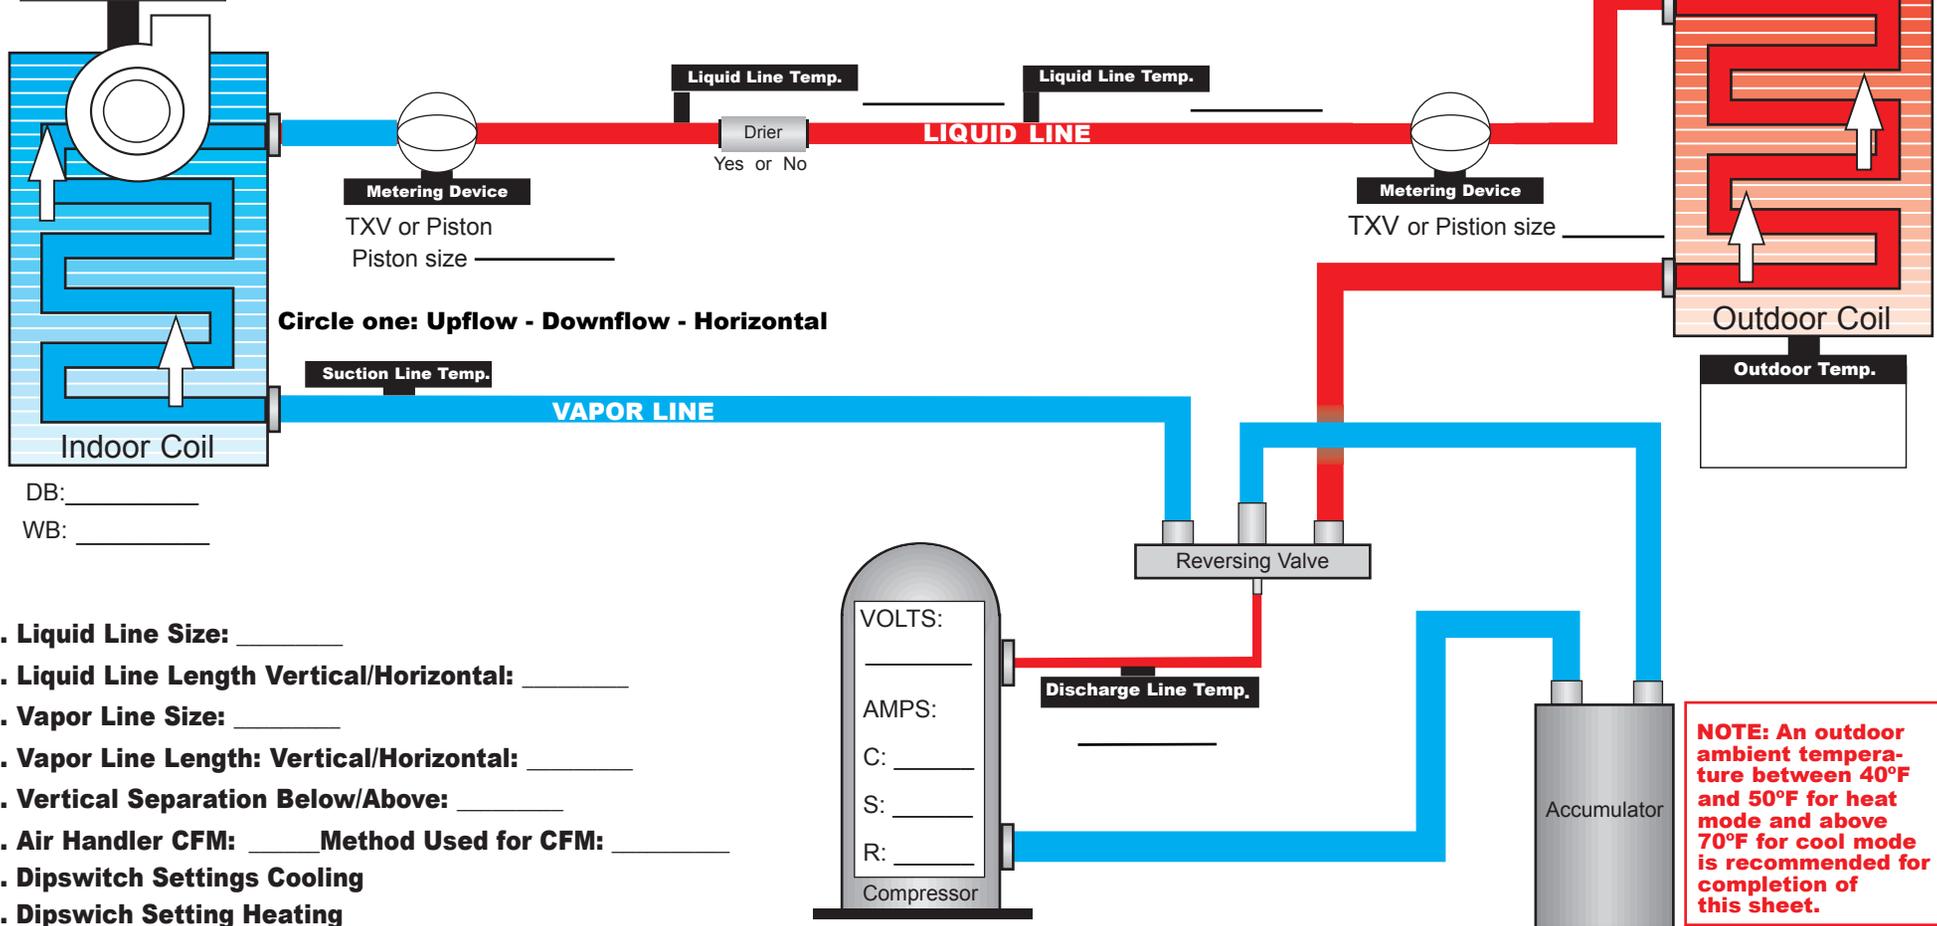

1. Liquid Line Size: _____
2. Liquid Line Length Vertical/Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length: Vertical/Horizontal: _____
5. Vertical Separation Below/Above: _____
6. Air Handler CFM: _____ Method Used for CFM: _____
7. Dipswitch Settings Cooling
8. Dipswitch Setting Heating

NOTE: An outdoor ambient temperature between 40°F and 50°F for heat mode and above 70°F for cool mode is recommended for completion of this sheet.