

AIR CONDITIONING JOBSITE INFORMATION SHEET


REMEMBER:

1. Circle Metering device used.
2. Circle Yes or No at drier locations.
3. Sat. Temp. is pressure converted to Temp.
4. Indicate Type of Coil

Saturation Temp.	Saturation Temp.	High Side PSIG
Saturation Temp.	Saturation Temp.	Low Side PSIG

Formula For Sub Cooling		
Sat Temp.	_____	
Minus Liquid Line Temp.	_____	
Equals Sub Cooling	_____	

Formula For Super Heat		
Vapor Line Temp.	_____	
Minus Sat Temp.	_____	
Equals Super Heat	_____	

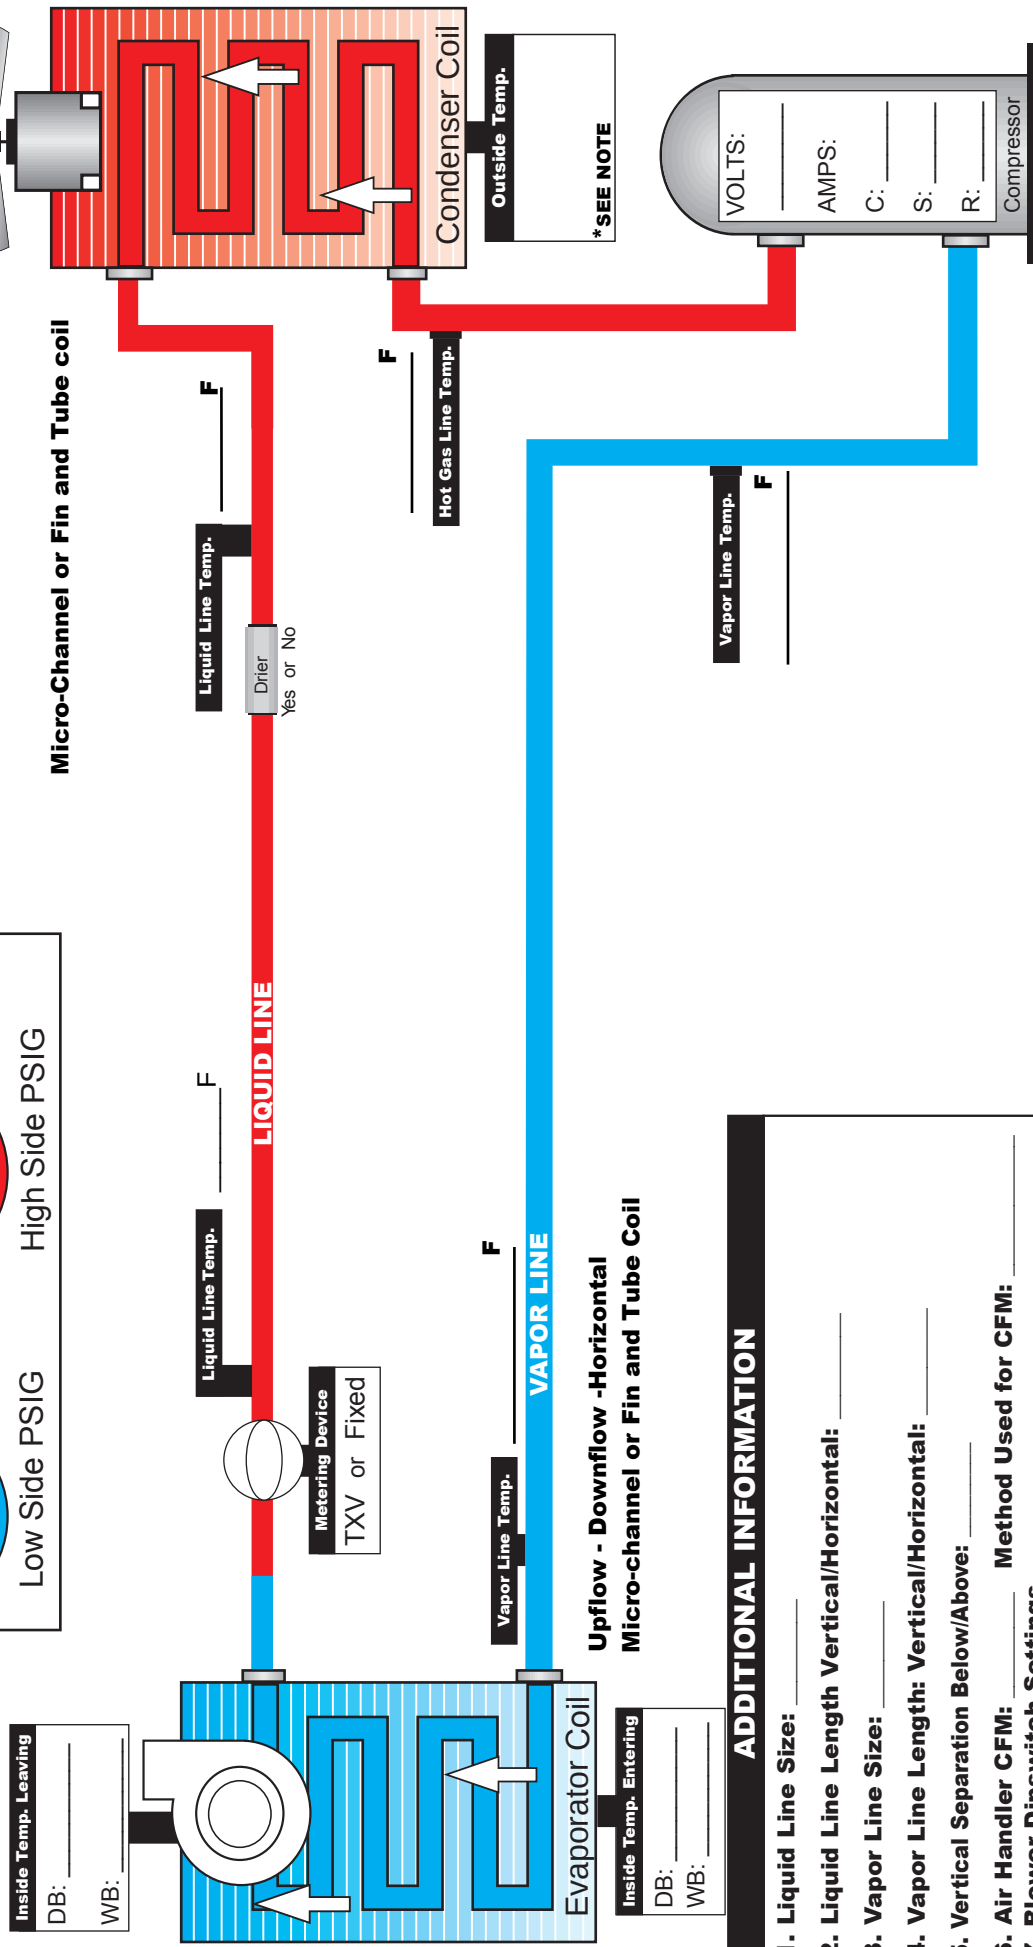

ADDITIONAL INFORMATION

1. Liquid Line Size: _____
2. Liquid Line Length Vertical/Horizontal: _____
3. Vapor Line Size: _____
4. Vapor Line Length: Vertical/Horizontal: _____
5. Vertical Separation Below/Above: _____
6. Air Handler CFM: _____ Method Used for CFM: _____
7. Blower Dipswitch Settings _____

NOTE: An outdoor ambient temperature above 70° F is recommended for completion of this sheet.